FIXTURE SCHEDULE

Description	Manufacturer	Model	NOTE	QTY
2'x4' PARABOLIC TROFFER	LITHONIA LIGHTING	2PM3N G B 3 32 18LD MVOLT 1/3 GEB10IS	RECESSED IN CEILING GRID	4
CEILING FAN WITH LIGHT	HUNTER	52" PALERMO 21617 / 27186 CONTROLLER	USE EXISING LOCATION	9
DIRECTIONAL EXIT SIGN	COOPER LIGHTING	AP70R	WALL MOUNTED	1
EXIT SIGN	COOPER LIGHTING	AP70R	WALL MOUNTED	2
INDOOR EMERGENCY LIGHT	COOPER LIGHTING	AP2SQ	WALL MOUNTED	3
SMOKE / HEAT DETECTOR	--	AS PER CODE REQUIREMENTS	-	3

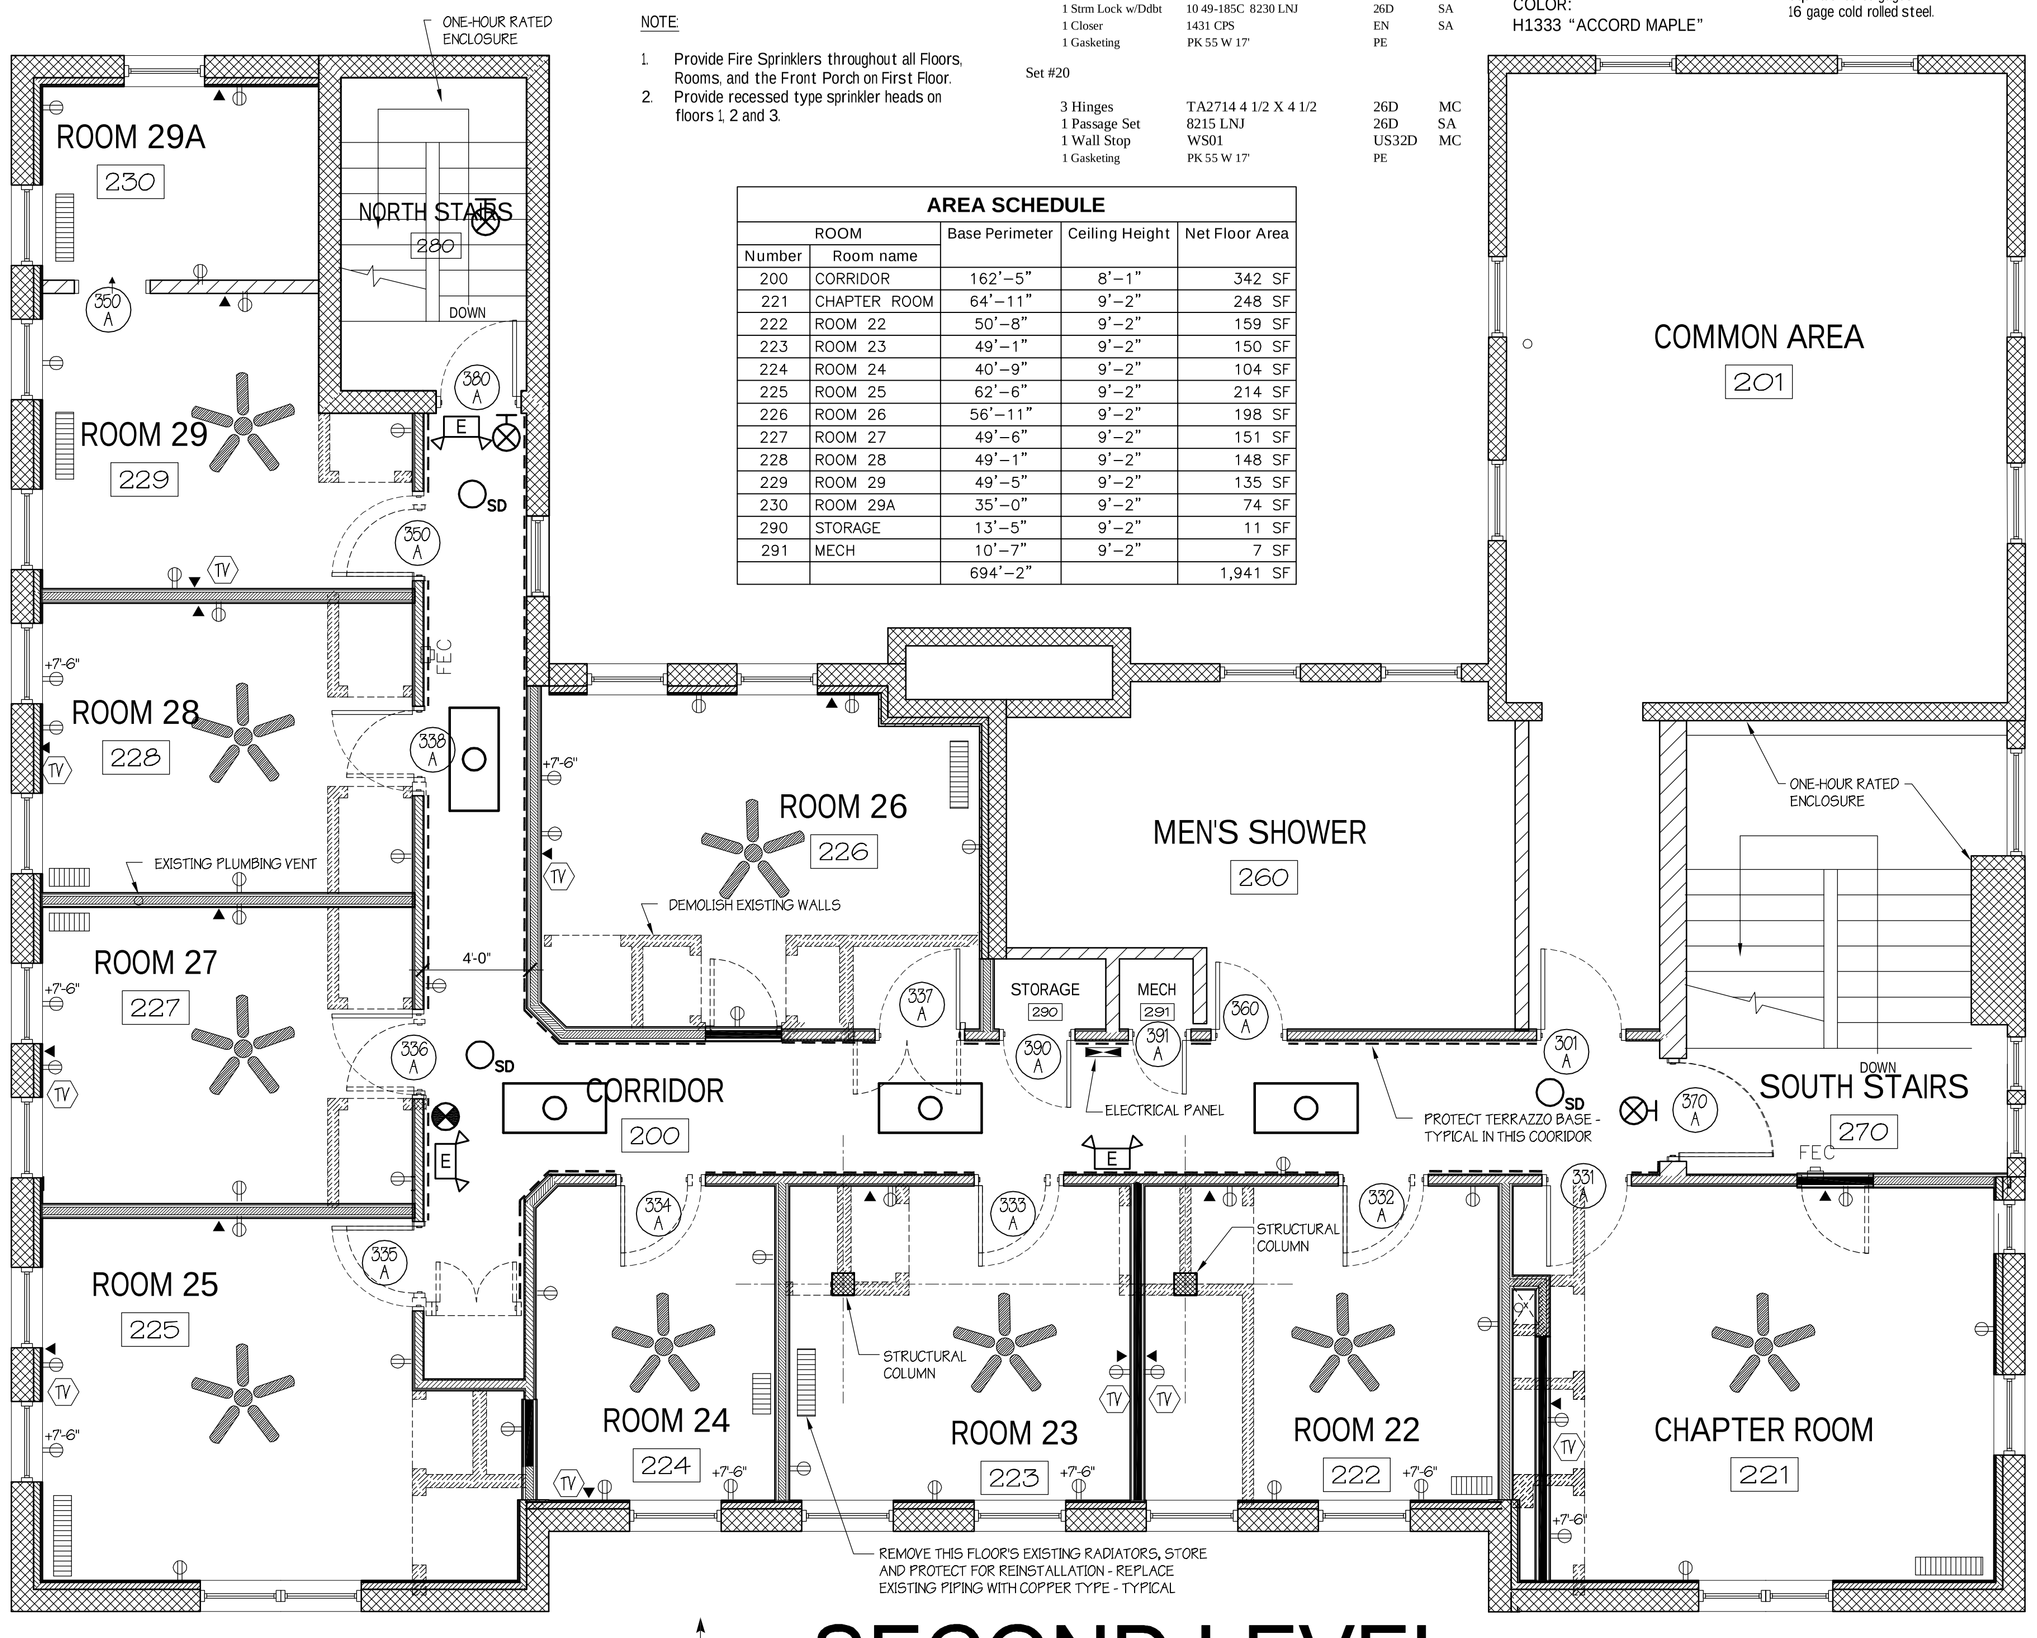

SECOND LEVEL

Drawing Scale
8'-0"

NOTE:

1. Provide Fire Sprinklers throughout all Floors, Rooms, and the Front Porch on First Floor.
2. Provide recessed type sprinkler heads on floors 1, 2 and 3.

AREA SCHEDULE

ROOM		Base Perimeter	Ceiling Height	Net Floor Area
Number	Room name			
200	CORRIDOR	162'-5"	8'-1"	342 SF
221	CHAPTER ROOM	64'-11"	9'-2"	248 SF
222	ROOM 22	50'-8"	9'-2"	159 SF
223	ROOM 23	49'-1"	9'-2"	150 SF
224	ROOM 24	40'-9"	9'-2"	104 SF
225	ROOM 25	62'-6"	9'-2"	214 SF
226	ROOM 26	56'-11"	9'-2"	198 SF
227	ROOM 27	49'-6"	9'-2"	151 SF
228	ROOM 28	49'-1"	9'-2"	148 SF
229	ROOM 29	49'-5"	9'-2"	135 SF
230	ROOM 29A	35'-0"	9'-2"	74 SF
290	STORAGE	13'-5"	9'-2"	11 SF
291	MECH	10'-7"	9'-2"	7 SF
		694'-2"		1,941 SF

Hardware Sets

SET #16

3 Hinges	T4A3786 4 1/2 X 4 1/2	26D	MC
1 Office Lock	10 8205 LNJ	26D	SA
1 Closer	1431 CPS	EN	SA
1 Overhead Stop	598S	26D	SA
1 Gasketing	PK 55 W 17'	PE	

SET #17

3 Hinges	T4A3386 4 1/2 x 4 1/2 NRP	32D	SA
1 Strm Lock w/Ddbt	10 49-185C 8230 LNJ	26D	SA
1 Closer	1431 CPS	EN	SA
1 Gasketing	PK 55 W 17'	PE	

Set #20

3 Hinges	TA2714 4 1/2 X 4 1/2	26D	MC
1 Passage Set	8215 LNJ	26D	SA
1 Wall Stop	WS01	US32D	MC
1 Gasketing	PK 55 W 17'	PE	

Typical Interior Door Specification:

Acceptable Door Manufacturer:
THE MAIMAN COMPANY

Door Type:
THERMAL FUSED FLUSH DOORS

COLOR:
H1333 "ACCORD MAPLE"

Hollow Metal Door Frames:

Provide the following Amweld brand frames at all locations specified: Series 800 two-piece adjustable frames for 1 3/4" doors.

Fabricate frames from the following gages and material using ANSI/SDI A250.8 and HMMA 803 for decimal equivalents to gages:
16 gage cold rolled steel.

DOOR AND FRAME SCHEDULE

NO.	ROOM	Style	SIZE-PR WxH	Hardware	Fire Rating	NOTES
201A	COMMON AREA	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
221A	CHAPTER ROOM	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
222A	ROOM 22	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
223A	ROOM 23	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
224A	ROOM 24	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
225A	ROOM 25	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
226A	ROOM 26	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
227A	ROOM 27	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
228A	ROOM 28	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
229A	ROOM 29	Hinged - Single Flush	3'-0" x 6'-8"	16	20 MINUTE	2
230A	ROOM 29A	Cased Opening	2'-6" x 6'-8"	-	-	-
260A	MEN'S SHOWER	Hinged - Single Flush	2'-6" x 6'-8"	20	20 MINUTE	2
270A	SOUTH STAIRS	Hinged - Single Flush	3'-6" x 6'-8"	16	90 MINUTE	2
280A	NORTH STAIRS	Hinged - Single Flush	2'-10" x 6'-8"	-	90 MINUTE	EXISTING, 1
290A	STORAGE	Hinged - Single Flush	2'-6" x 6'-8"	17	20 MINUTE	2
291A	MECH	Hinged - Single Flush	2'-0" x 6'-8"	17	20 MINUTE	2

REMARKS :
1. EXISTING DOOR TO REMAIN
2. EXISTING LOCATION OF DOOR OPENING

- 2x4 STUDS @ 16" O.C. WITH 7/16" WOOD SHEATHING, 1/2" ACOUSTICAL BOARD AND 5/8" GYPSUM Type "X" WALL BOARD EACH FACE
- 2x4 STUDS @ 16" O.C. WITH 7/16" WOOD SHEATHING, 1/2" ACOUSTICAL BOARD AND 5/8" GYPSUM Type "X" WALL BOARD EACH FACE
- EXISTING EXTERIOR MASONRY WALL WITH FURRED OUT WALL - SEE DETAIL ON Sheet A-501
- EXISTING EXTERIOR MASONRY WALL
- EXISTING INTERIOR PARTITION WALL

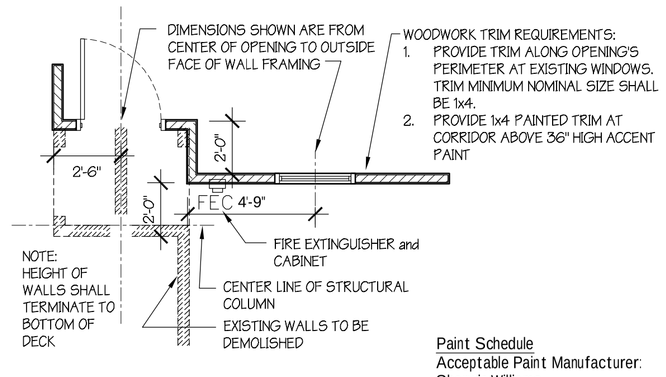

- STEAM HEAT RADIANTOR
- FLOOR SINK
- FLOOR DRAIN
- ±0" ±0" ELEVATION SYMBOLS
- Ceiling Fan Light Fixture
- SD Smoke and Heat Detector
- Directional Exit Sign
- Wall mounted Exit Sign
- E Emergency Strobes Lighting
- Flourescent Light Fixture

Paint Schedule
Acceptable Paint Manufacturer:
Sherwin Williams

FIELD PAINT:
Drywall, Electrical Panels
1 ct. Premium Wall & Wood Primer
2 cts. Duration Home Interior Semi-Gloss
Color: SW6119, "Whole Wheat"

CEILING PAINT:
1 ct. Premium Wall & Wood Primer
2 cts. Duration Home Interior SW7007 "CEILING WHITE"; FLAT SHEEN

Accent paint :
Drywall
1 ct. Premium Wall & Wood Primer
2 cts. Duration Home Interior Semi-Gloss
Color: SW6121 "Whole Wheat"

WOOD TRIM, Radiators, AND HOLLOW METAL FRAMES :
1 ct. Premium Wall & Wood Primer
2 cts. ProClassic Interior Waterbased Acrylic-Alkyd Semi-Gloss Color: SW7027 "WELL-BRED BROWN"; GLOSS SHEEN

Architect:

AIA CSI CCS CCCA NCARB LEED AP
Thomas McInerney
ARCHITECT
www.thomasarchitect.com
1208 MARCY STREET IOWA CITY, IOWA 52240
319-331-0365
thomas@thomasarchitect.com

ANY ELECTRICAL AND MECHANICAL ITEMS SHOWN ARE DIAGRAMMATIC AND ARE SHOWN FOR THE LIMITED PURPOSE OF INDICATING LOCATIONS OF REQUIRED FIXTURES. MECHANICAL AND ELECTRICAL CONTRACTORS SHALL PROVIDE DESIGNS IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS REQUIRED BY THE AUTHORITY HAVING JURISDICTION. CONTRACTOR SHALL COORDINATE THE INSTALLATION OF NEW SYSTEMS WITH EXISTING SYSTEMS.

Project : ΣN
THE SIGMA NU RENOVATIONS
630 DUBUQUE STREET
Iowa City, IOWA

Project number: 09.03

Note: © COPYRIGHT
UNAUTHORIZED COPYING, DISCLOSURE OR CONSTRUCTION WITHOUT WRITTEN PERMISSION BY THOMAS MCINERNEY, ARCHITECT, IS PROHIBITED.

Issue date:

Date	Description
2011.04.14	PERMIT REVIEW

Sheet Title:
plans and details

Sheet Number:
a-102

C:\Users\Thomas\Documents\0903_Sigma_Nu\0903_SET_Master.dwg, 0903_A-102_24x36, 4/18/2011 3:54:51 PM, Thomas McInerney Architect, Copyright 2011

PDF created with pdfFactory trial version www.pdffactory.com